

D. Y. Patil Education Society's

D. Y. Patil Technical Campus

Faculty of Engineering & Faculty of Management

Talsande-416112 District: Kolhapur (Accredited by NAAC 'A' Grade with 3.25 CGPA in First Cycle)

Criterion 7-Institutional Values and Best Practices

Key Indicator-7.1 Institutional Values and Social Responsibilities

7.1.2 The Institution has facilities for alternate sources of energy & conservation measures.

- 1. Solar Energy
- 2. Biogas Plant
- 3. Sensor based energy conservation
- 4. Use of LED Bulbs/power efficient equipment



Solar Energy




D. Y. Patil Education Society's


D. Y. Patil Technical Campus

Faculty of Engineering & Faculty of Management

Talsande-416112 District: Kolhapur (Accredited by NAAC 'A' Grade with 3.25 CGPA in First Cycle)

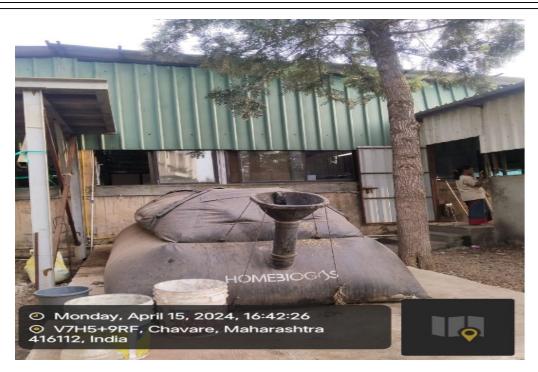

Biogas Plant

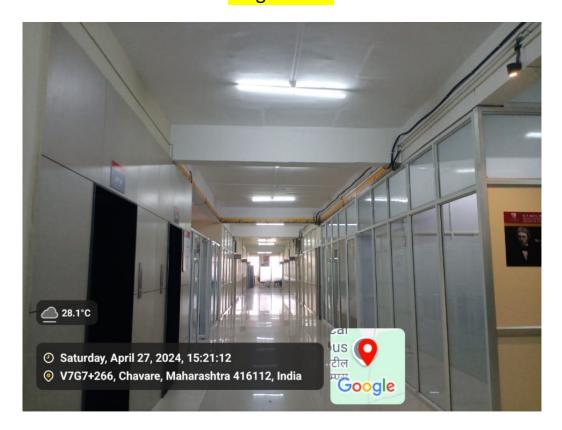




D. Y. Patil Education Society's

D. Y. Patil Technical Campus

Faculty of Engineering & Faculty of Management

Talsande-416112 District: Kolhapur (Accredited by NAAC 'A' Grade with 3.25 CGPA in First Cycle)

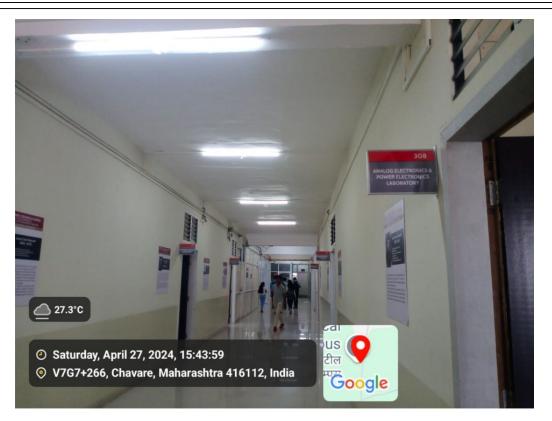

Use of LED Bulbs/power efficient equipment